





607 · 358 · 1000  
FAX · 358 · 1800

ENGINEERS • ARCHITECTS • SURVEYORS  
AIRPORT CORPORATE PARK, 100 HUNT CENTER, HORSEHEADS, N.Y. 14845

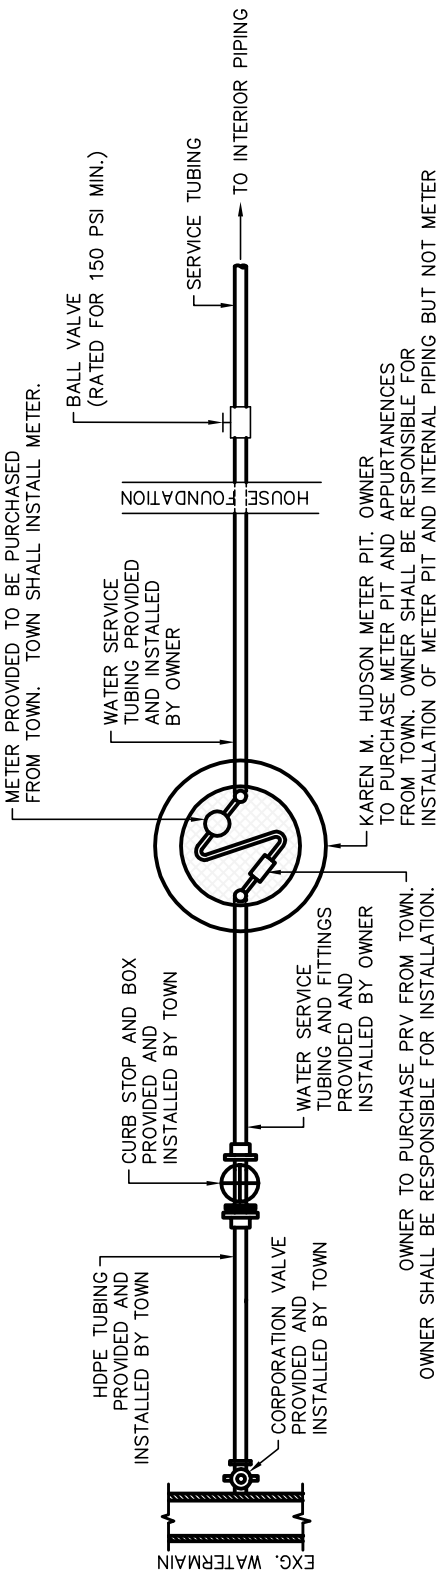

WATER SERVICE PLAN VIEW

NOTE: ALL SERVICE TUBING INSTALLED BY OWNER SHALL BE OF MATERIALS APPROVED BY THE TOWN OF PULTENEY (e.g. TYPE K COPPER OR HDPE DR-9 SERVICE TUBING)

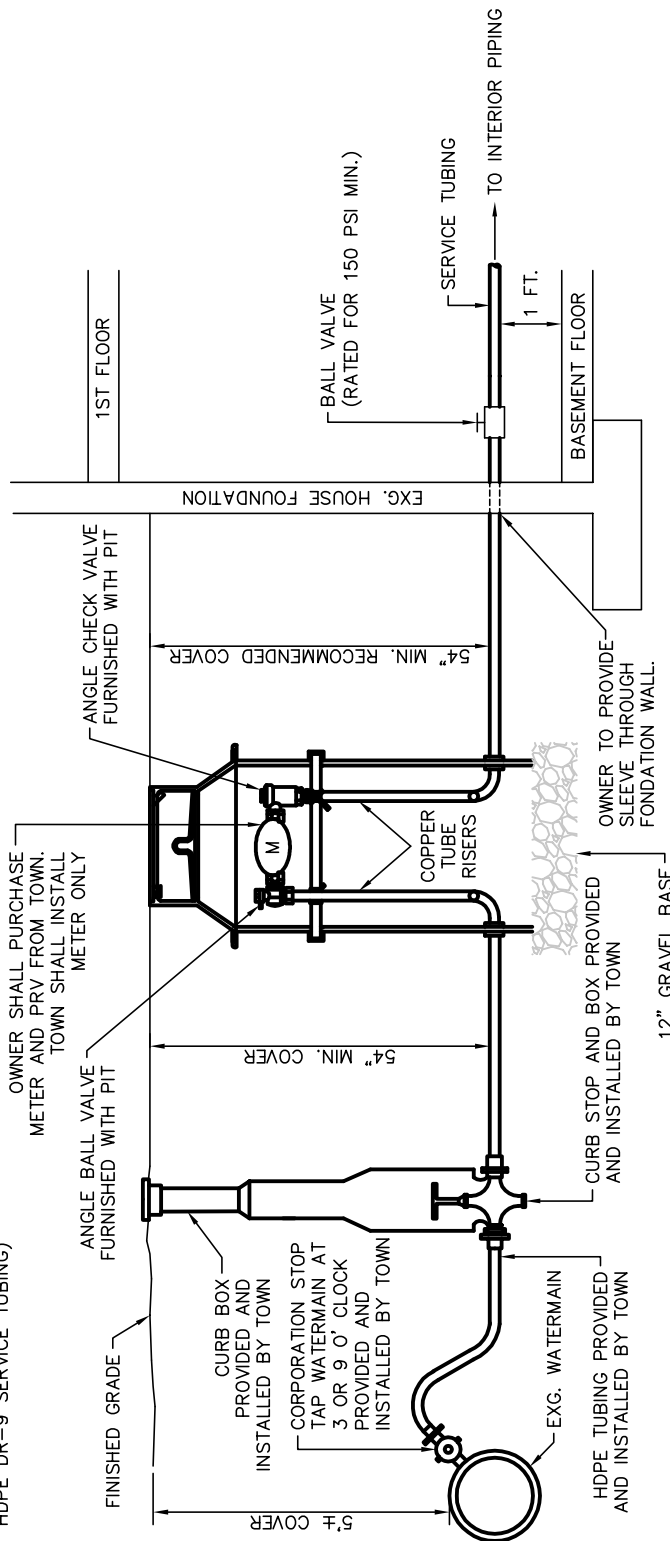

NOTE: SINGLE FAMILY RESIDENTIAL WATER SERVICES SHALL BE EITHER 3/4-INCH DIAMETER TYPE K COPPER TUBING OR 1-INCH DIAMETER HDPE TUBING. HDPE TUBING SHALL BE DR-9 WITH TRACER WIRE, 200 PSI RATED. REFER TO PERMIT APPLICATION FOR SERVICE LINE SPECIFICATION.

WATER SERVICE SIDE VIEW

WATER SERVICE INSTALLATION DETAIL WITH METER PIT

TOWN OF PULTENEY WATER DEPARTMENT (PHONE: 607-868-3808)  
9226 COUNTY ROUTE 74  
TOWN OF PULTENEY, STEUBEN COUNTY, NEW YORK 14874