


NOTE: OWNER SHALL PURCHASE METER FROM TOWN TOWN SHALL INSTALL METER ONLY.

BASEMENT MUST BE ACCESSIBLE AND HAVE A MINIMUM CLEARANCE OF 5 FT. FROM FLOOR TO CEILING. IF SUFFICIENT ROOM DOES NOT EXIST, THE WATER METER MUST BE INSTALLED IN AN ACCESSIBLE AREA ON THE FIRST FLOOR.

WATER SERVICE PLAN VIEW

NOTE: ALL SERVICE TUBING INSTALLED BY OWNER SHALL BE OF MATERIALS APPROVED BY THE TOWN OF PULTENEY

(e.g. TYPE K COPPER OR HDPE DR-9 SERVICE TUBING)

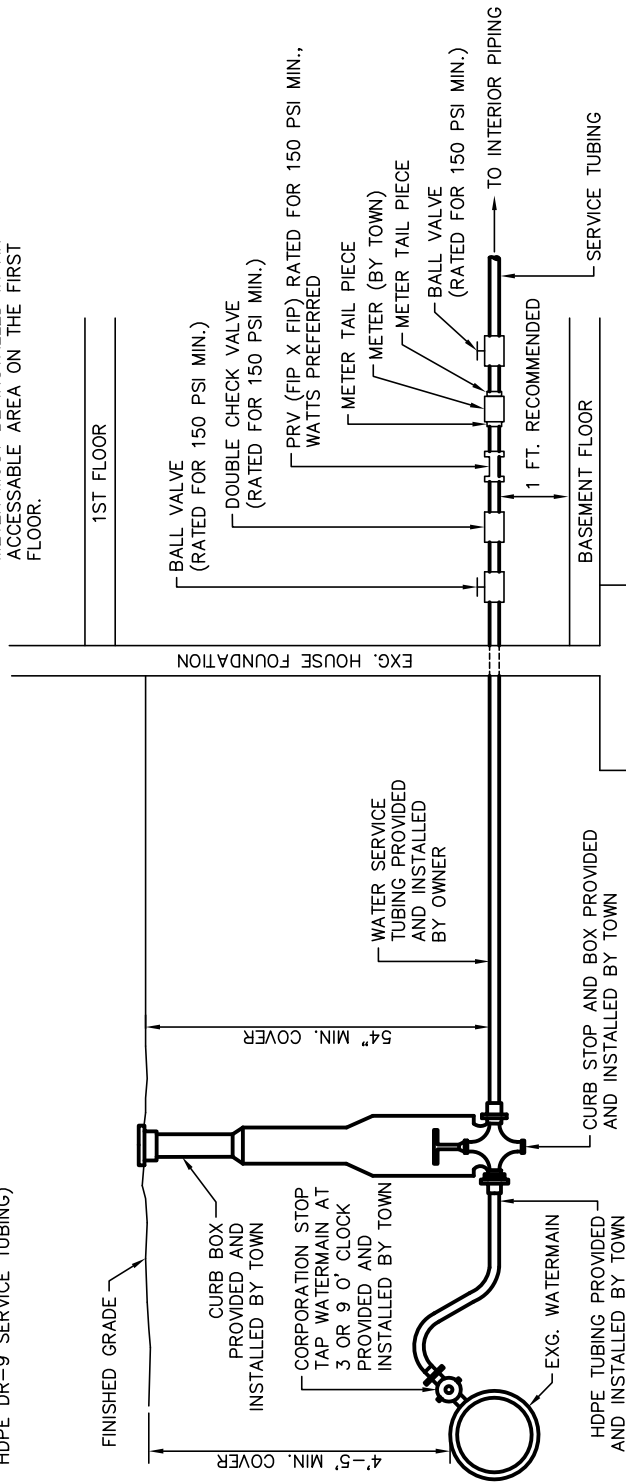

NOTE: SINGLE FAMILY RESIDENTIAL WATER SERVICES SHALL BE EITHER 3/4-INCH DIAMETER TYPE K COPPER TUBING OR 1-INCH DIAMETER HDPE TUBING. HDPE TUBING SHALL BE DR-9 WITH TRACER WIRE, 200 PSI RATED.

WATER SERVICE SIDE VIEW

REVISED: DECEMBER 28, 2007



607 · 358 · 1000
FAX · 358 · 1800

ENGINEERS • ARCHITECTS • SURVEYORS
AIRPORT CORPORATE PARK, 100 HUNT CENTER, HORSEHEADS, N.Y. 14845

WATER SERVICE INSTALLATION DETAIL WITHOUT METER PIT

TOWN OF PULTENEY WATER DEPARTMENT (PHONE: 607-868-3808)
9226 COUNTY ROUTE 74
TOWN OF PULTENEY, STEUBEN COUNTY, NEW YORK 14874